

**REPORT**

FOR: Global Technology Systems

Sound Transmission Loss  
Test RAL™-TL95-363ON: Badger Cork 2.5 mm AcoustiCORK™  
Underlayment With A Floating Floor  
On 6" Precast Concrete Slabs  
With Suspended 5/8" Gypsum CeilingPage 1 of 3

CONDUCTED: 13 November 1995

TEST METHOD

Unless otherwise designated, the measurements reported below were made with all facilities and procedures in explicit conformity with the ASTM Designations E90-90 and E413-87, as well as other pertinent standards. Riverbank Acoustical Laboratories has been accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) for this test procedure. A description of the measuring technique is available separately. The microphone used was a Bruel & Kjaer serial number 1440522.

DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the client as a Badger Cork 2.5 mm AcoustiCORK™ underlayment with a floating floor on 6" precast concrete slabs with suspended 5/8" gypsum ceiling. The overall dimensions of the specimen were nominally 4.27 m (168 in.) wide by 6.10 m (240 in.) long and 412 mm (16.20 in.) thick. The specimen was constructed directly in the laboratory's 4.27 m (14 ft) by 6.10 m (20 ft) test opening and was sealed on the periphery (both sides) with a dense mastic. The description of the specimen was as follows: From the top down, the floor consisted of a 14 mm (0.5625 in.) thick floating wood floor, manufactured by Universal Flooring Limited, set on Badger Cork 2.5 mm (0.10 in.) thick, AcoustiCORK™ underlayment. The 2.5 mm AcoustiCORK™ was set on a 6mm plastic vapor barrier which was laid directly on the concrete slab sub-floor. The sub-floor consisted of ten nominally 610 mm (24 in.) wide by 4.23 m (166.5 in.) by 152 mm (6 in.) thick wire reinforced concrete slabs. Split drive pins were inserted into the bottom of the slabs on 1.22 m (48 in.) centers and used to tie 12 gauge hanger wire for the suspended ceiling. The hanger wires were tied to allow for a nominal 229 mm (9 in.) plenum depth from the bottom of the slabs to the top of the ceiling. Cold rolled steel carrying channels were tied to the hanger wires and twelve 24 gauge galvanized steel DWC channels (hat channels) were saddle tied perpendicular to the cold rolled channels with double strands of 24 gauge tie wire. A layer of 16 mm (0.625 in.) thick Type X wallboard was attached to the DWC channels. The joints between the wallboard sheets were taped and covered with joint compound. The plenum between the sub-floor and the ceiling contained a single layer of 89 mm (3.5 in.) thick, R-11 unfaced fiberglass insulation. The weight of the entire specimen as determined was 5,758.7 kg (12,695.5 lbs) an average of 221.5 kg/m<sup>2</sup> (45.3 lbs/ft<sup>2</sup>). The transmission area used in the calculations was 26 m<sup>2</sup> (280 ft<sup>2</sup>). The source and receiving room temperatures at the time of the test were 22°C (72±2°F) and 61±2% relative humidity.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY  
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.  
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES  
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

**REPORT**

Global Technology Systems

RAL™-TL95-363

13 November 1995

Page 2 of 3TEST RESULTS

Sound transmission loss values are tabulated at the eighteen standard frequencies. A graphic presentation of the data and additional information appear on the following pages. The precision of the TL test data are within the limits set by the ASTM Standard E90-90.

<u>FREQ.</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>	<u>FREQ.</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>
100	28	0.13	0	800	65	0.27	0
125	40	0.18	3	1000	70	0.30	0
160	44	0.13	2	1250	74	0.28	0
200	43	0.13	6	1600	78	0.22	0
250	47	0.23	5	2000	80	0.21	0
315	50	0.21	5	2500	79	0.14	0
400	53	0.15	5	3150	85 *	0.13	0
500	58	0.27	1	4000	88 *	0.14	0
630	62	0.26	0	5000	86 *	0.09	0

STC = 59

## ABBREVIATION INDEX

FREQ. = FREQUENCY, HERTZ, (cps)

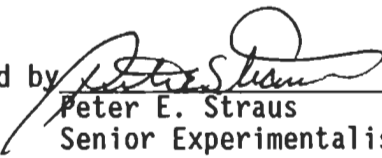
T.L. = TRANSMISSION LOSS, dB

C.L. = UNCERTAINTY IN dB, FOR A 95% CONFIDENCE LIMIT

DEF. = DEFICIENCIES, dB&lt;STC CONTOUR

STC = SOUND TRANSMISSION CLASS

\* = INDICATES A CORRECTION WAS APPLIED TO THE DATA DUE TO BACKGROUND NOISE LEVELS IN THE RECEIVING ROOM

Submitted by   
Peter E. Straus  
Senior ExperimentalistReviewed by   
John W. Kopec  
Laboratory Manager

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY  
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.  
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES  
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.